

# GWS



- Versatile
  - Sealed combustion option allows use of outside combustion air
- Factory tested
- Compact design
- Easy service
  - One-piece access door
  - Plug-in wiring
  - Control module with diagnostic lights
- High efficiency
  - AFUE's to 85.3%
  - Spark-ignited pilot with electronic control
- Cast iron sections with built-in air separator
- Insulated heavy-gauge steel jacket
- Limited lifetime warranty

## Gas-fired Water Boilers

- Sealed combustion system
- Factory-packaged
- 63,000 to 158,000 Btuh Input  
Natural or propane gas



**Williamson**

## RATINGS

Boiler model number	0–2,000 feet altitude		2,000–4,500 feet altitude (Canada) ①		Net I=B=R ratings	Boiler water content Gallons	DOE seasonal efficiency % A.F.U.E ②	Vent size	Circulator flange size (Recommended supply & return pipe size, NPT)
	Input	Output (DOE Heating Capacity)	Input	Output					
	Btuh	Btuh ②	Btuh	Btuh					
<b>GWS-063</b> ③	63,000	54,000	56,700	48,600	47,000	1.5	85.3	3"	1"
<b>GWS-090E</b> ③	90,000	77,000	81,000	69,300	67,000	2.1	85.0	3"	1"
<b>GWS-095</b>	95,000	81,000	85,500	72,900	70,000	2.1	84.6	3"	1"
<b>GWS-127</b>	127,000	107,000	114,300	96,300	93,000	2.7	84.0	3"	1"
<b>GWS-158</b>	158,000	133,000	142,200	119,700	115,000	3.3	83.4	3"	1¼"

① Contact your dealer regarding information and parts for high altitude applications.  
 ② Based on standard test procedures prescribed by the United States Department of Energy.  
 ③ As an Energy Star Partner, Williamson has determined that the GWS-063 & GWS-090E meets the Energy Star guidelines for energy efficiency.  
 ④ Net I=B=R ratings are based on net installed radiation of sufficient quantity for the requirements of the building and nothing need be added for normal piping and pickup. Ratings are based on a piping and pickup allowance of 1.15. Additional allowance should be made for unusual piping and pickup loads.




## DIMENSIONS


ALL DIMENSIONS IN INCHES

GWS boilers are CSA design certified for installation on combustible flooring. (Do not install on carpeting.)

**VENTING:** Use only AL29-4C venting per instructions in Boiler Manual.

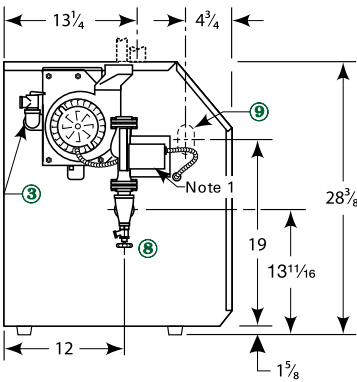

LEFT SIDE

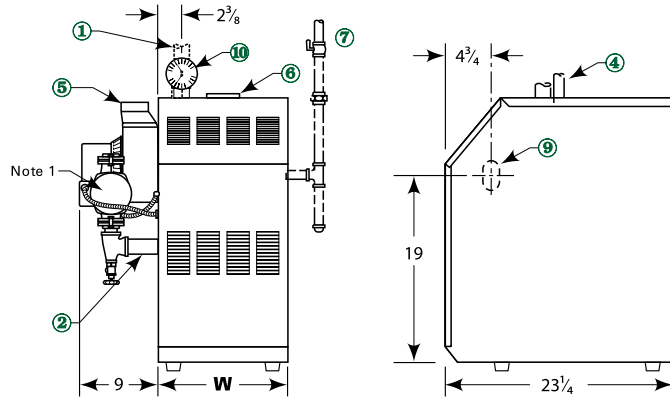

FRONT


RIGHT SIDE

Boiler model	W
	Width
<b>GWS-063</b>	13
<b>GWS-090E</b>	16
<b>GWS-095</b>	16
<b>GWS-127</b>	19
<b>GWS-158</b>	22

- ① Supply piping (Note 1)
- ② Return piping (Note 1)
- ③ Relief valve, 3/4" NPT
- ④ 1/2" NPT to expansion tank/air vent
- ⑤ Vent connection, 3" diameter
- ⑥ 3/3 1/2" diameter air pipe connection
- ⑦ Gas supply piping
- ⑧ Drain valve
- ⑨ Gas supply entrance (right or left side)
- ⑩ Pressure/temperature gauge (in tee on supply)

Note 1: Boiler supply and return tappings are 1 1/2" NPT. Circulator flanges shipped with boiler are sized to recommended pipe size listed in RATINGS table, above.  
 Boiler circulator is shipped loose. Circulator may be mounted on either boiler supply or return piping.

## ORDER CODE

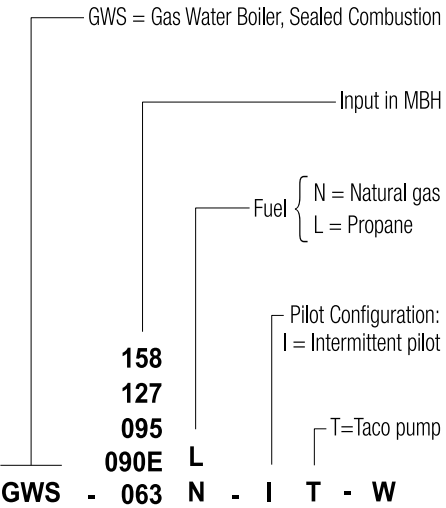

## EQUIPMENT

- Factory tested
- Insulated extended steel jacket
- Cast iron sections with built-in air separator
- Induced-draft blower assembly
- Air pressure switch
- Stainless steel burners
- Electrical junction box
- 24-VAC combination gas valve
- 40VA control transformer
- Plug-in wiring
- Taco 007 circulator
- High temperature limit control
- 30 PSIG ASME relief valve
- Combination pressure/temperature gauge
- Spark-ignited (intermittent) pilot system
- Electronic ignition/flame supervisory control

## WARRANTY

- Limited lifetime warranty on heat exchanger
- 1-year limited warranty on parts
- Optional 5- or 10-year parts and labor warranty



8201 W. Calumet Road • Milwaukee, WI 53223  
 www.williamson-thermofo.com Form W-003(06/09)